




Sensor Analysis Report

Name: Pharmacy Storage
Module: S003196
Time Range: From 21.Jul.2020 21:35 to 26.Jul.2020 04:54

Upper Alarm Limit:	25 °C	Total Time Above Limit:	10:20:00	Sensor Alarms:	3
Upper Alarm Delay:	2 Logging interval(s)	Total Time Below Limit:	00:00:00		
Lower Alarm Limit:	15 °C	Highest Value:	25.5 °C; 22.Jul.2020 16:00:00		
Lower Alarm Delay:	2 Logging interval(s)	Lowest Value:	23.5 °C; 25.Jul.2020 06:00:00		
Logging Interval:	10 Minute(s)	Average Value:	24.4 °C	Standarddeviation:	0.451
MKT:	24.4 °C			Number of Measurements:	620

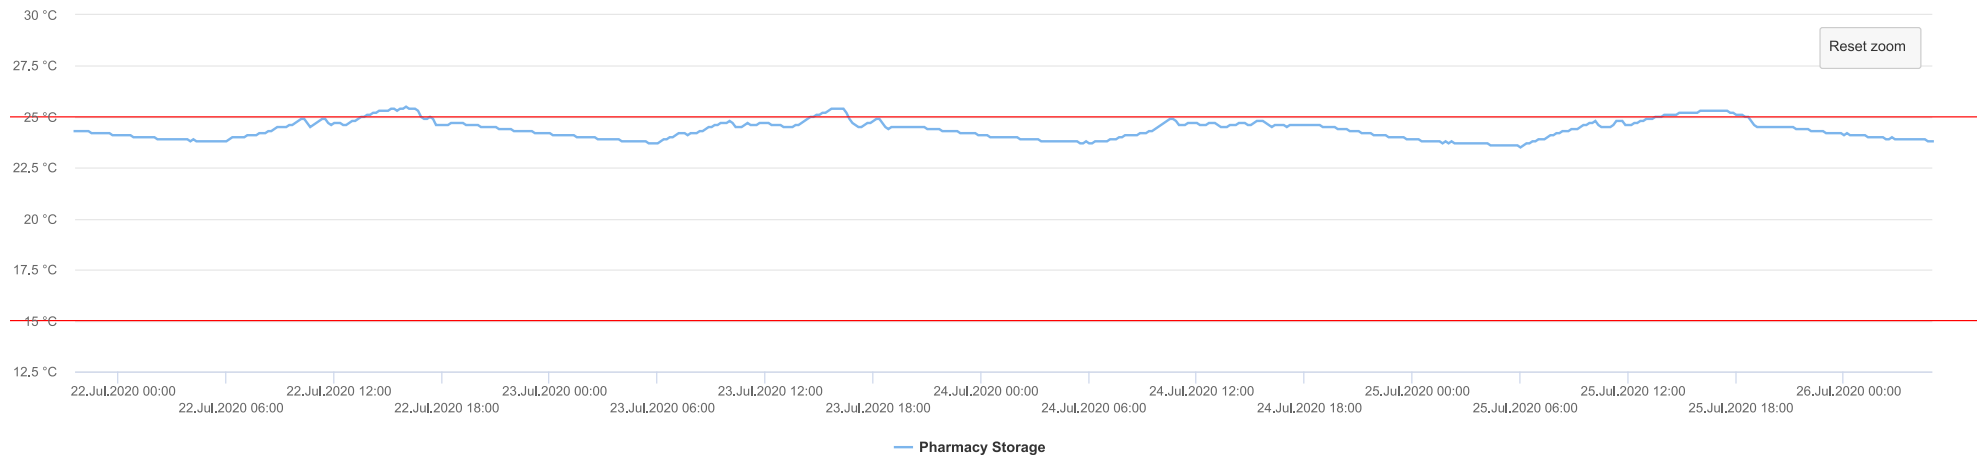

Incident No.	Date/Time	Event	Module Id	Sensor Name	User
61552	07/25/2020 18:30:00	Deviation no longer active	S003196	Pharmacy Storage	System
	Key	Value			
	Sensor name	Pharmacy Storage			
	Upper alarm limit	25			
	Lower alarm limit	15			
	Upper alarm delay	2			
	Lower alarm delay	2			
	Missing value delay	5			
	Radio connection threshold	-100			
	Radio connection delay	10			
	Sensor value	25			
	Sensor unit	°C			
	Sensor Id	127			
	Entry reason	Value above alarm limit			
61332	07/22/2020 14:10:00	Deviation occurred	S003196	Pharmacy Storage	System
	Key	Value			
	Sensor name	Pharmacy Storage			
	Upper alarm limit	25			
	Lower alarm limit	15			
	Upper alarm delay	2			
	Lower alarm delay	2			
	Missing value delay	5			
	Radio connection threshold	-100			
	Radio connection delay	10			
	Sensor value	25.2			
	Sensor unit	°C			
	Sensor Id	127			
	Entry reason	Value above alarm limit			
61425	07/23/2020 16:40:00	Deviation no longer active	S003196	Pharmacy Storage	System
	Key	Value			
	Sensor name	Pharmacy Storage			

Incident No.	Date/Time	Event	Module Id	Sensor Name	User
	Key	Value			
	Upper alarm limit	25			
	Lower alarm limit	15			
	Upper alarm delay	2			
	Lower alarm delay	2			
	Missing value delay	5			
	Radio connection threshold	-100			
	Radio connection delay	10			
	Sensor value	24.9			
	Sensor unit	°C			
	Sensor Id	127			
	Entry reason	Value above alarm limit			

61552	07/25/2020 14:20:00	Deviation occurred	S003196	Pharmacy Storage	System
	Key	Value			
	Sensor name	Pharmacy Storage			
	Upper alarm limit	25			
	Lower alarm limit	15			
	Upper alarm delay	2			
	Lower alarm delay	2			
	Missing value delay	5			
	Radio connection threshold	-100			
	Radio connection delay	10			
	Sensor value	25.1			
	Sensor unit	°C			
	Sensor Id	127			
	Entry reason	Value above alarm limit			

61332	07/22/2020 16:50:00	Deviation no longer active	S003196	Pharmacy Storage	System
	Key	Value			
	Sensor name	Pharmacy Storage			
	Upper alarm limit	25			
	Lower alarm limit	15			
	Upper alarm delay	2			
	Lower alarm delay	2			

Incident No.	Date/Time	Event	Module Id	Sensor Name	User
	Key	Value			
	Missing value delay	5			
	Radio connection threshold	-100			
	Radio connection delay	10			
	Sensor value	25			
	Sensor unit	°C			
	Sensor Id	127			
	Entry reason	Value above alarm limit			
61425	07/23/2020 15:10:00	Deviation occurred	S003196	Pharmacy Storage	System
	Key	Value			
	Sensor name	Pharmacy Storage			
	Upper alarm limit	25			
	Lower alarm limit	15			
	Upper alarm delay	2			
	Lower alarm delay	2			
	Missing value delay	5			
	Radio connection threshold	-100			
	Radio connection delay	10			
	Sensor value	25.2			
	Sensor unit	°C			
	Sensor Id	127			
	Entry reason	Value above alarm limit			